
Foundation earthing schematic with galvanised wire

Foundation plan: closed ring, middle branch, clamps and tap-offs

GALVANIZED STEEL ROUND WIRE · RWG 010 · Ø10 · 78 mm² · HOT-DIP 70 µm

KALOT GROUP · TECHNICAL ILLUSTRATION · NOT TO SCALE

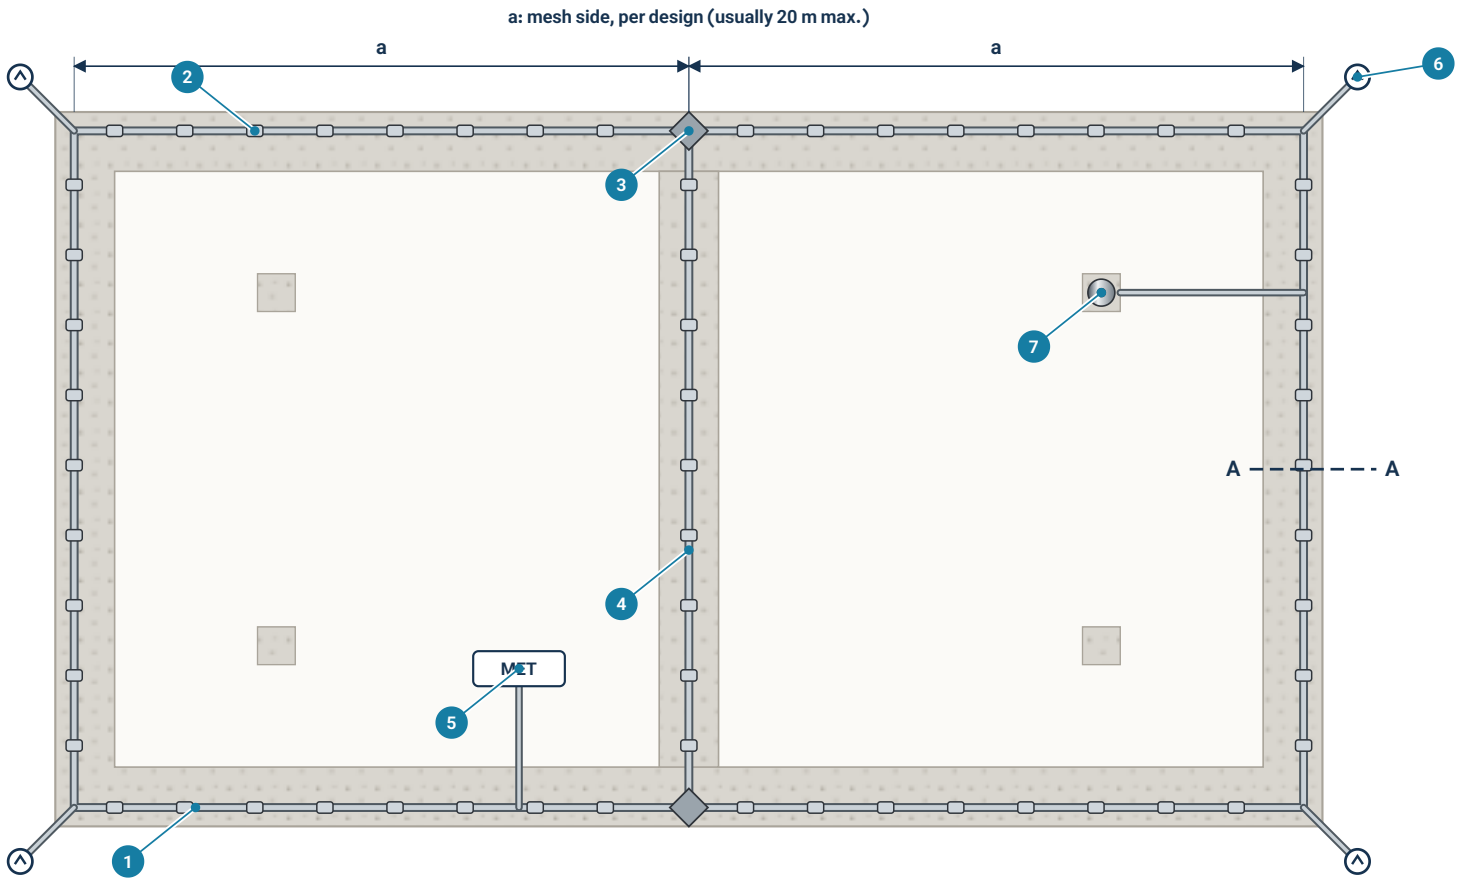

1. Closed ring on the lowest reinforcement layer, near the outer edge of the foundation
2. Wire to reinforcement clamp, at least every 2 m
3. Galvanised cross clamp at crossings
4. Central branch; mesh size as designed
5. Tap-off to the main earthing terminal, inside the building
6. Tap-off for each down conductor, above ground level
7. Stainless steel bonding point on a column or wall

Illustrative schematic, not to scale; the design sets mesh sizes and the number of tap-offs.
We keep improving our products; please confirm final dimensions with our experts.

This document is not contractual; we may update product design, dimensions, weights and images without prior notice.

گروه کالوت
KALOT GROUP
Protect Today For Tomorrow
Since: 1972 تاسیس: ۱۳۵۱
www.kalot.ir · Tel +98 21 2268 8852