
Installing the conductor-to-tape clamp on the down conductor route

Down conductor tape from above, 50 or 70 mm² round conductor from below to the earthing system

INTERFACE TEST CLAMP · ITCT

KALOT GROUP · TECHNICAL ILLUSTRATION · NOT TO SCALE

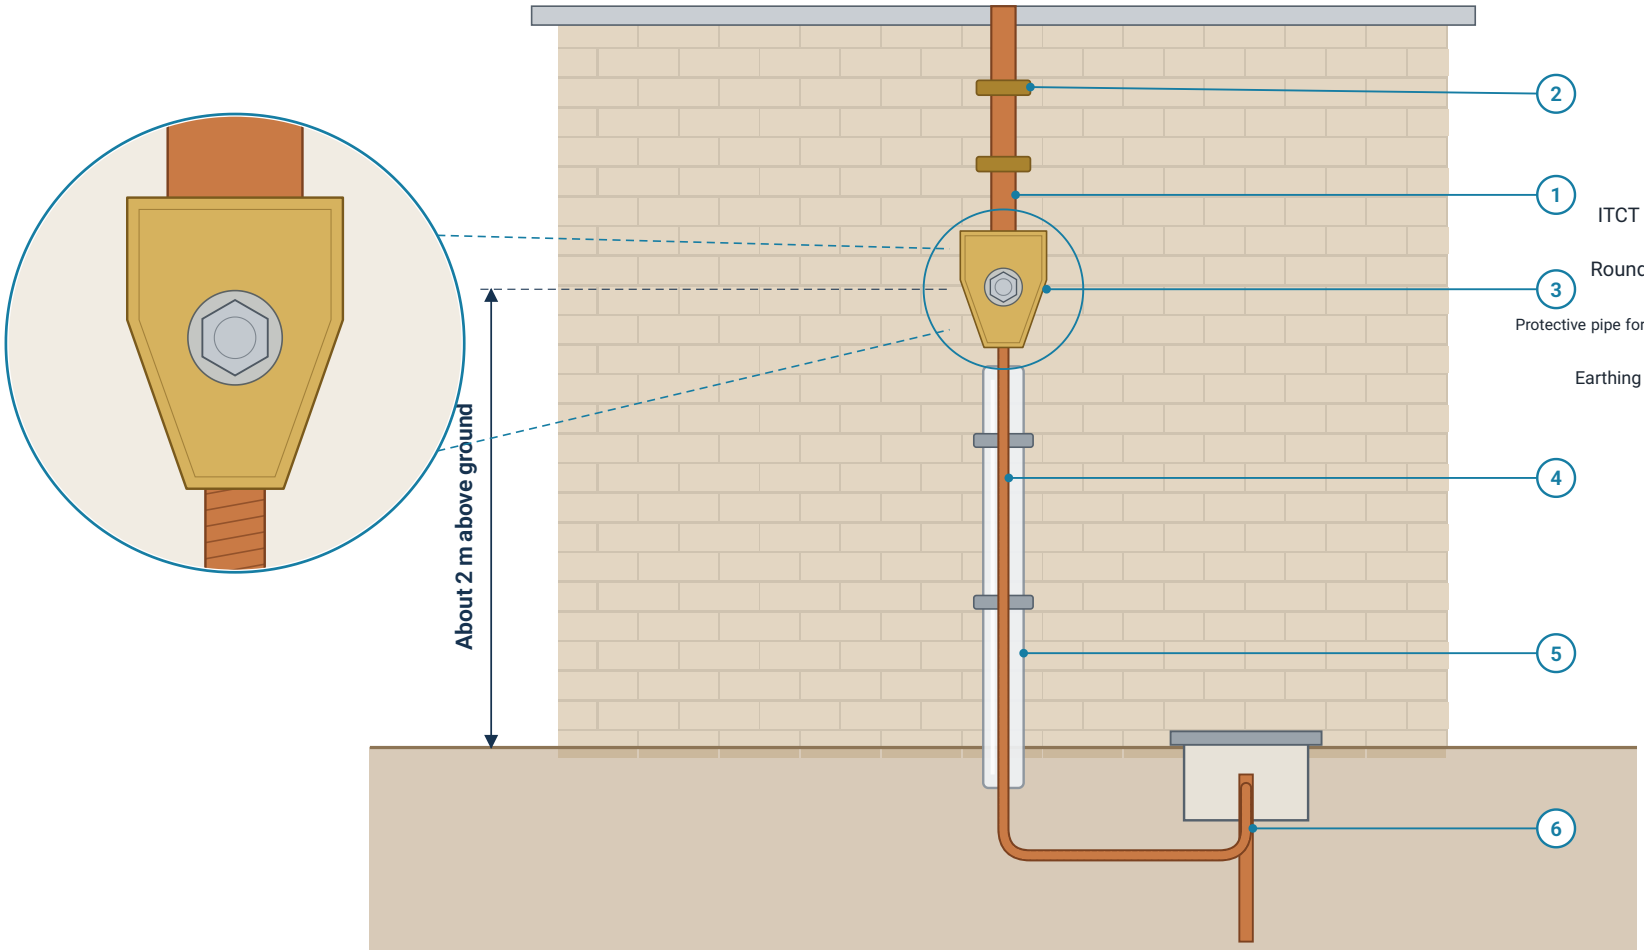

1. Down conductor: copper tape
2. Wall clip holding the tape
3. ITCT two-way conductor-to-tape clamp
4. Round copper conductor, 50 or 70 mm²
5. Protective pipe for the conductor down to below ground level
6. Earthing system (electrode and inspection pit)

This document is not contractual; we may update product design, dimensions, weights and images without prior notice.

گروه کالوت
KALOT GROUP
Protect Today For Tomorrow
Since: 1972 تاسیس: ۱۳۵۱
www.kalot.ir · Tel +98 21 2268 8852