
Conductor connection modes in the raised floor pedestal earth clamp

Front view · conductors in clamp grooves · not to scale


KALOT GROUP · TECHNICAL ILLUSTRATION · NOT TO SCALE

c) Green and yellow insulated conductor

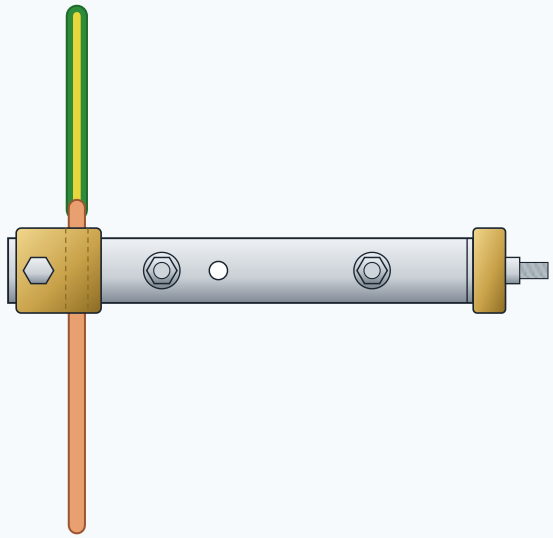


Insulation is stripped only at the clamp.

b) Two conductors

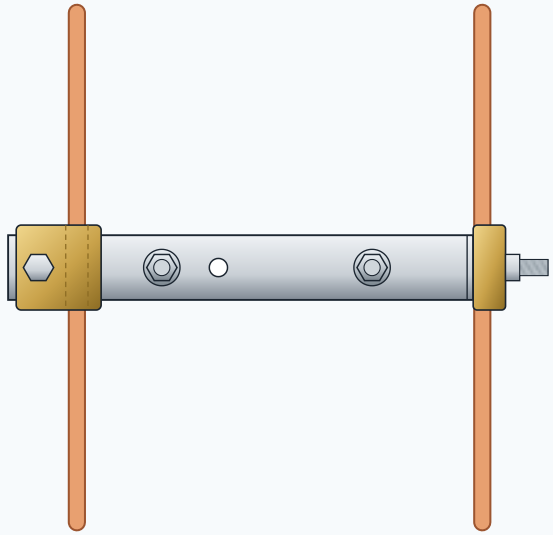

One conductor in the clamp on the strap, the second in the clamp on the bent end.

a) One conductor

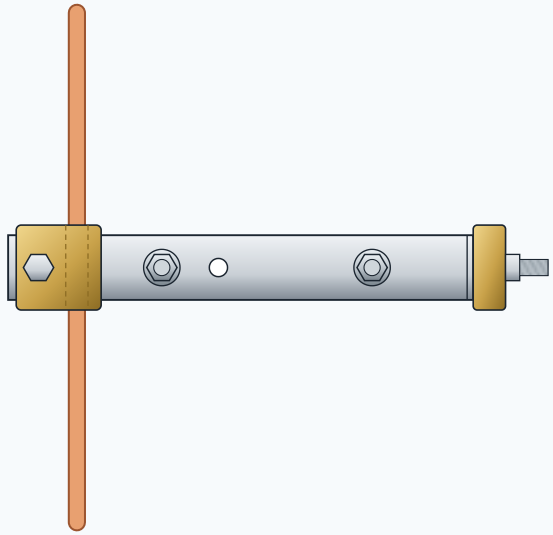

Conductor in the clamp groove on the strap.

Conductor routes and sizes are illustrative; agree conductor type and size with our specialists when ordering.

This document is not contractual; we may update product design, dimensions, weights and images without prior notice.

گروه کالوت
KALOT GROUP
Protect Today For Tomorrow
Since: 1972 تاسیس: ۱۳۵۱
www.kalot.ir · Tel +98 21 2268 8852