
Test joint installed in the down conductor route

25×3 tape from above, 50 mm² conductor from below to the earthing system

SPECIAL TEST CLAMP · SKADL 100

KALOT GROUP · TECHNICAL ILLUSTRATION · NOT TO SCALE

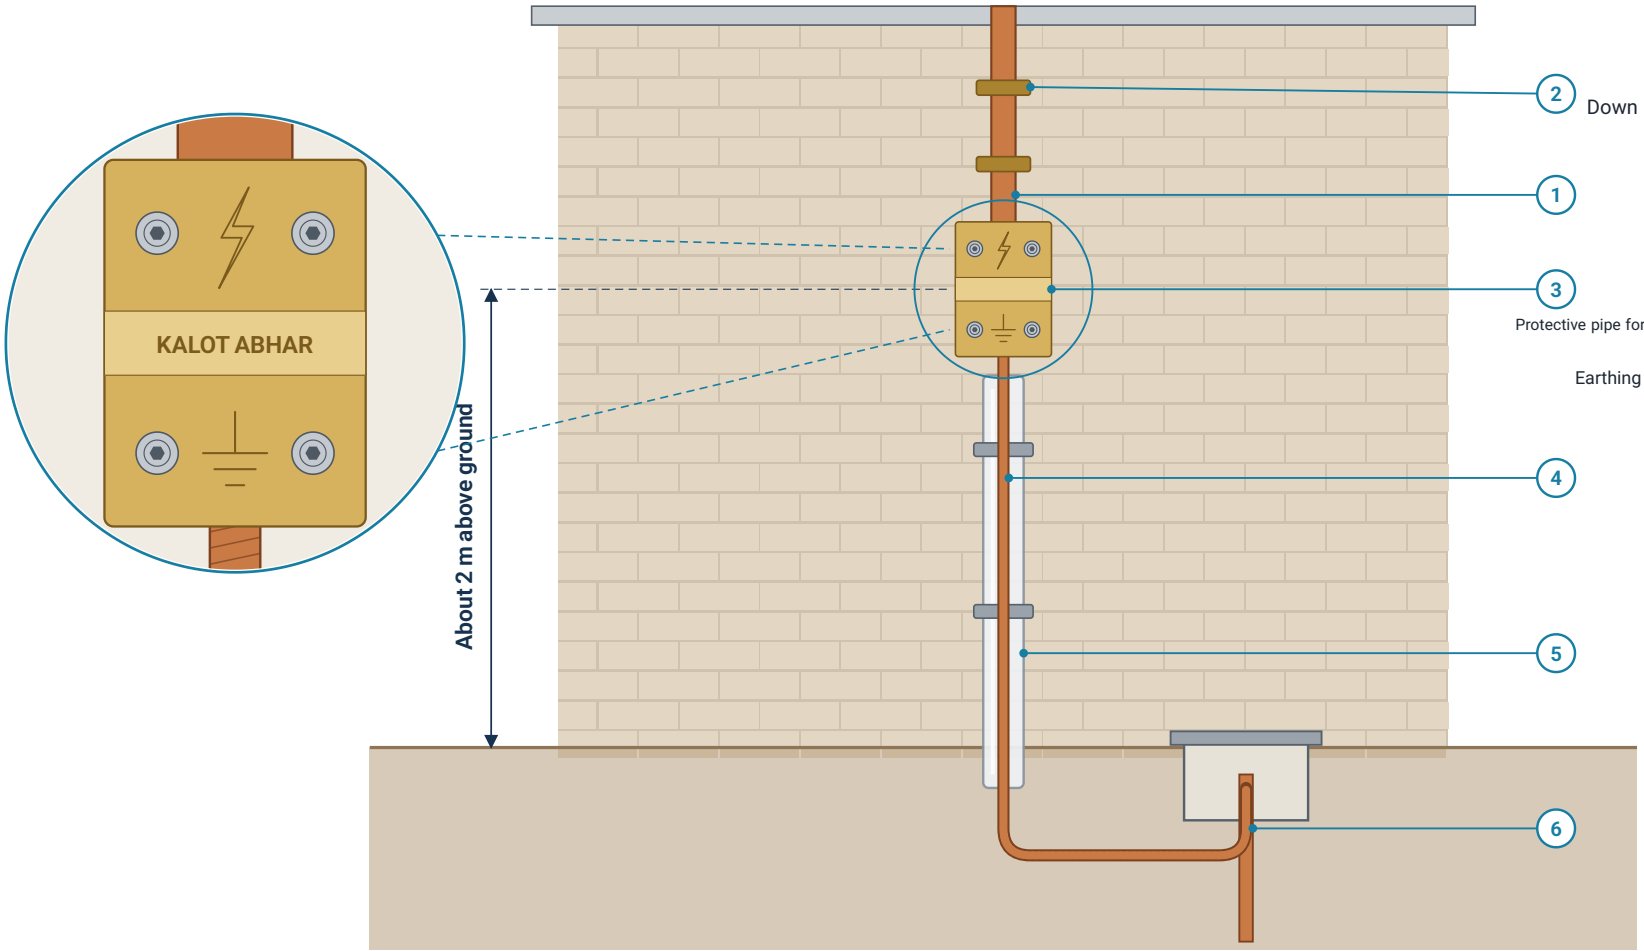

2. Down conductor: 25×3 mm copper tape (1)
1. Wall clip holding the tape (2)
3. SKADL 100 brass test joint (3)
4. 50 mm² earth conductor (4)
5. Protective pipe for the conductor down to below ground level (5)
6. Earthing system (electrode and inspection pit) (6)

This document is not contractual; we may update product design, dimensions, weights and images without prior notice.

گروه کالوت
KALOT GROUP
Protect Today For Tomorrow
Since: 1972 تاسیس: ۱۳۵۱
www.kalot.ir · Tel +98 21 2268 8852